
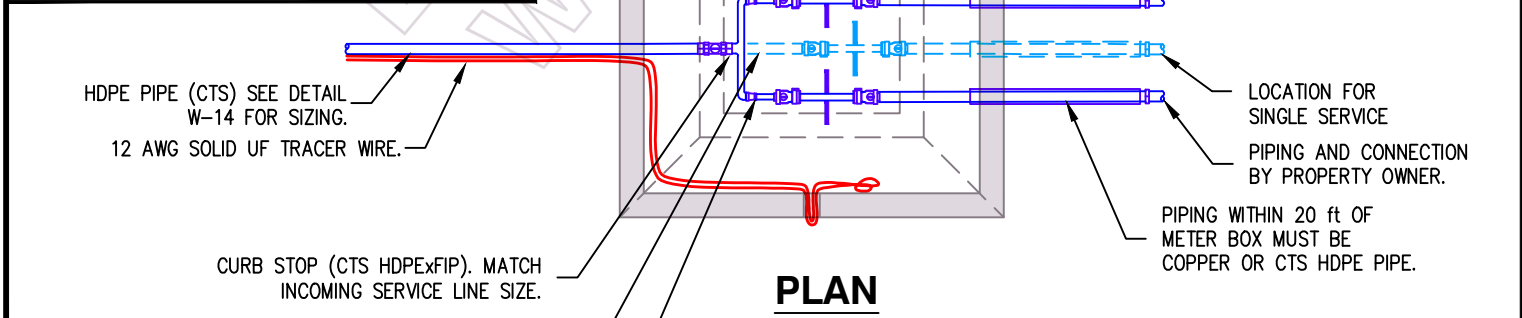


**SETTERS**

SIZE	FORD	McDONALD	MUELLER
3/8" x 3/4"	VBB73-8W-11-33-7-5-FP-NL	20-D207-JJ-DD-33	5/8x3/4x8 B-2404N
1"	VBB74-10W-11-44-FP-NL	20-412-JJ-DD-44	1x10 B-2404N
	ADAPTERS C84-xx-Q		ADAPTER H-14222

- NOTES:
- SETTER MODEL NUMBERS CHANGE FREQUENTLY. CONFIRM WITH SUPPLIER AND DISTRICT.
  - SETTERS SHALL BE FULL SIZE (FULL-PORT) PIPE, VALVES, AND FITTINGS.
    - 3/8" x 3/4" SETTER: 3/4" I.D. (0.875" O.D.).
    - 1" SETTER: 1" I.D. (1.125" O.D.).
  - 3/4" METER MAXIMUM 20 GPM RATING.
  - 1" METER MAXIMUM 50 GPM RATING.

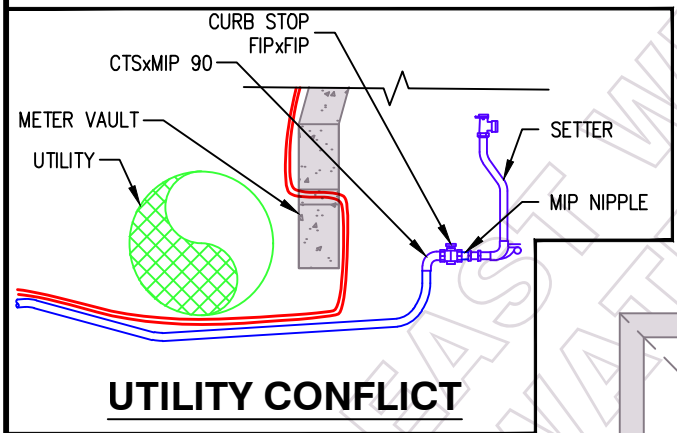

- 1) COMPACT SOIL UNDER AND AROUND VAULT ASSEMBLY TO 90% OF MAXIMUM DENSITY FOR UNTRAVELED AREAS, AND 95% IN ROADS, DRIVES AND SIDEWALKS.
- 2) SEE DRAWING W-29 FOR METER VAULT INSTALLATION DETAILS.
- 3) PRESSURE TEST ENTIRE SERVICE THROUGH SETTER AND TAILPIPE AT 250 psi. TEMPORARY SETTER JUMPERS AND TAILPIPE CAPS FOR TESTING CAN BE PROVIDED BY THE DISTRICT. RETURN TO DISTRICT AFTER TESTING.

**East Wenatchee  
Water District**



**WATER SYSTEM STANDARD DETAIL  
3/4" AND 1" SINGLE AND DOUBLE  
WATER SERVICES**